




Front View

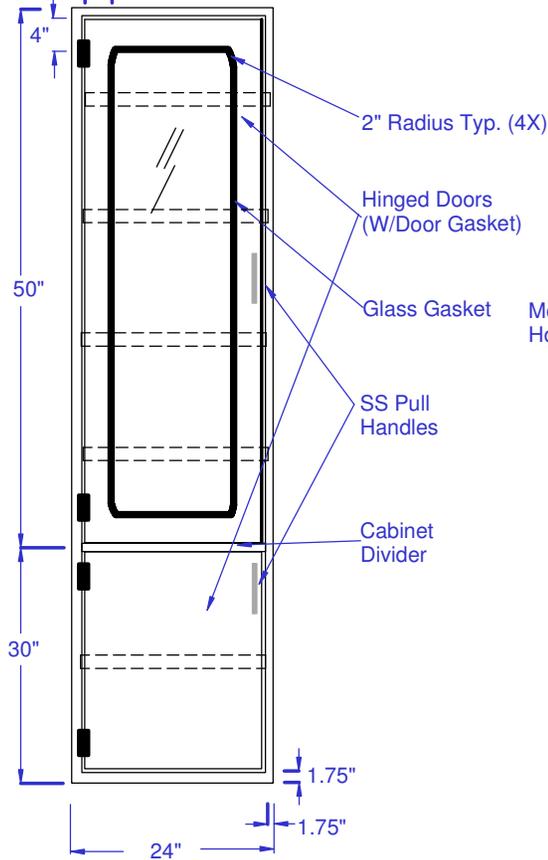

Side View

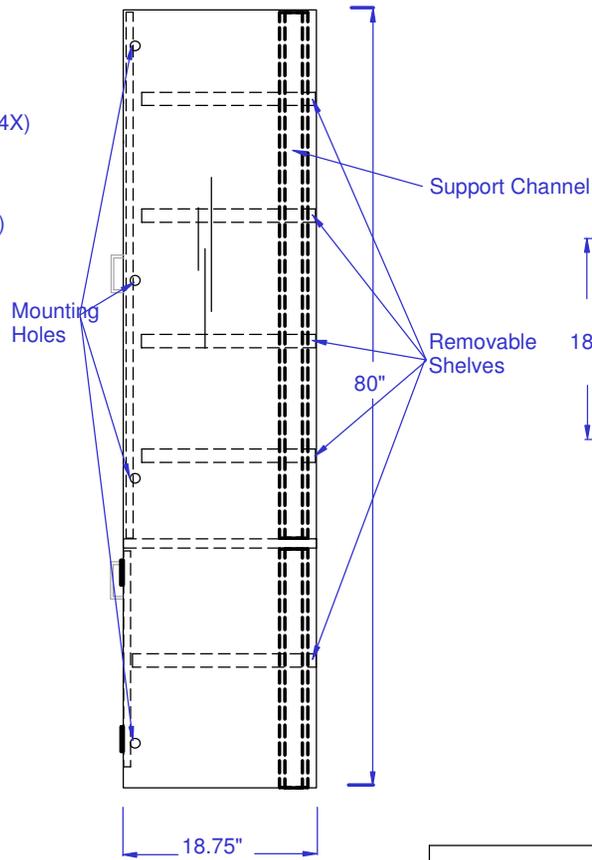

Top View

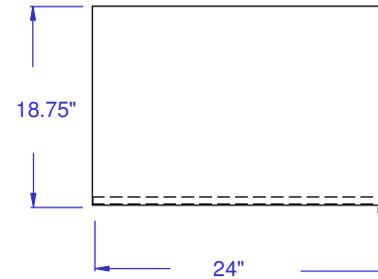

STANDARDS:
 ALL TIG WELDS CLEANED
 ALL EDGES SMOOTHED
 CORNERS TIG WELDED
 AND GROUND SMOOTH
 BEND RADIUS IS .125"



PROPRIETARY
 THIS DOCUMENT AND THE DATA DISCLOSED
 HEREIN OR HEREWITH IS NOT TO BE
 REPRODUCED, USED OR OTHERWISE DISCLOSED
 IN WHOLE OR IN PART TO ANYONE WITHOUT
 THE WRITTEN AUTHORIZATION FROM
 G2 AUTOMATED TECHNOLOGIES, LLC

A4

Approvals		Date	GAT-CAB-18.752480-1-4-SS
Drawn By J. Lamb Approved By N/A		9/28/11	
TITLE SS Surgical Cabinet Left Hinged Upper Door Left Hinged Lower Door (5) Removable Shelves		Material: SS 304 #3 Cabinet Body and Door Mcmaster-Carr # 1726A8 SS Pull Handle Southco # EH-6A-5V5-50 Hinge Southco # J-EH-6A-10V8 SS Ball Catch	
SIZE N/A	CAGE CODE	DWG NO 18.752480-Overall	REV
SCALE Not To Scale	Qty.: 1	SHEET	

PLEASE RETURN A SIGNED COPY TO G2. EACH DRAWING IS TO BE SIGNED AND DATED INDICATING CUSTOMERS APPROVAL. G2 MUST OBTAIN APPROVAL ON DRAWINGS PRIOR TO THE FABRICATION OF ANY PRODUCTS. ALL AMENDMENTS MADE AFTER THE APPROVAL OF THESE DRAWINGS WILL BE AT THE EXPENSE OF THE CUSTOMER.

Approval: _____
Date: _____